



Test Report issued under the responsibility of:



TEST REPORT
IEC 60947-5-1
Part 5: Control circuit devices and switching elements
Electromechanical control circuit devices

Report Number..... : 00901-CB2020CQC-091895
Date of issue..... : 2022-8-18
Total number of pages 38



Name of Testing Laboratory preparing the Report : Shanghai Testing & Inspection Institute for Electrical Equipment Co. Ltd. (STIEE)

Applicant's name : ORISM TECHNOLOGY PTE. LTD.

Address..... : 2 VENTURE DRIVE #11-31 VISION EXCHANGE SINGAPORE

Test specification:

Standard : IEC 60947-5-1: 2016

Test procedure : CB Scheme

Non-standard test method : N/A

Test Report Form No. : IEC60947_5_1F

Test Report Form(s) Originator : DEKRA Certification B.V.

Master TRF : Dated 2021-05-02

Copyright © 2019 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.




If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.


This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

| | | |
|---|--|---|
| Test item description : | Relay | |
| Trade Mark : |  | |
| Manufacturer | SHANGHAI EASCO ELECTRICAL CO.,LTD./ Rm 118,Bldg 20,No.1-42,Lane 83,N.Hongxiang Road,Lingang New Area, China (Shanghai) | |
| Model/Type reference | YX series | |
| Ratings | See page 12 | |
| Responsible Testing Laboratory (as applicable), testing procedure and testing location(s): | | |
| <input checked="" type="checkbox"/> | CB Testing Laboratory: | Shanghai Testing & Inspection Institute for Electrical Equipment Co. Ltd. (STIEE) |
| Testing location/ address : | | 505 Wu Ning Road Shanghai P. R. China |
| Tested by (name, function, signature) : | | Yin Jifu/Engineer  |
| Approved by (name, function, signature) ... : | | Wei Qingyuan/Senior engineer  |
| <input type="checkbox"/> | Testing procedure: CTF Stage 1: | |
| Testing location/ address : | | |
| Tested by (name, function, signature) : | | |
| Approved by (name, function, signature) ... : | | |
| <input type="checkbox"/> | Testing procedure: CTF Stage 2: | |
| Testing location/ address : | | |
| Tested by (name + signature) | | |
| Witnessed by (name, function, signature) . : | | |
| Approved by (name, function, signature) ... : | | |
| <input type="checkbox"/> | Testing procedure: CTF Stage 3: | |
| <input type="checkbox"/> | Testing procedure: CTF Stage 4: | |
| Testing location/ address : | | |
| Tested by (name, function, signature) : | | |
| Witnessed by (name, function, signature) . : | | |
| Approved by (name, function, signature) ... : | | |
| Supervised by (name, function, signature) : | | |

| | | | | | | | | | | | | |
|--|---------------|----|-----|----|---|----|-----|------|-----|-----|--|-------------------|
| List of Attachments (including a total number of pages in each attachment): N/A N/A | | | | | | | | | | | | |
| Summary of testing: N/A | | | | | | | | | | | | |
| Tests performed (name of test and test clause): | | | | | | | | | | | Testing location: Shanghai Testing & Inspection Institute for Electrical Equipment Co. Ltd. (STIEE)/ 505 Wu Ning Road Shanghai P. R. China | |
| Type | Test Sequence | | | | | | | | | | | |
| | I | II | III | IV | V | VI | VII | VIII | EMC | CTI | | Glow-wire testing |
| YX542AH00 | × | - | - | - | - | - | - | - | - | - | | - |
| YX511 | - | × | - | - | - | - | - | - | - | - | | - |
| YX511 | - | × | - | - | - | - | - | - | - | - | | - |
| YX511 | - | - | × | - | - | - | - | - | - | - | | - |
| YX511 | - | - | - | × | - | - | - | - | - | - | | - |
| YX511 | - | - | - | - | - | - | - | - | × | - | | - |
| YX511 | - | - | - | - | - | - | - | - | - | × | × | |
| Summary of compliance with National Differences (List of countries addressed): N/A | | | | | | | | | | | | |
| <input type="checkbox"/> The product fulfils the requirements of _____ (insert standard number and edition and delete the text in parenthesis, leave it blank or delete the whole sentence, if not applicable) | | | | | | | | | | | | |



Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

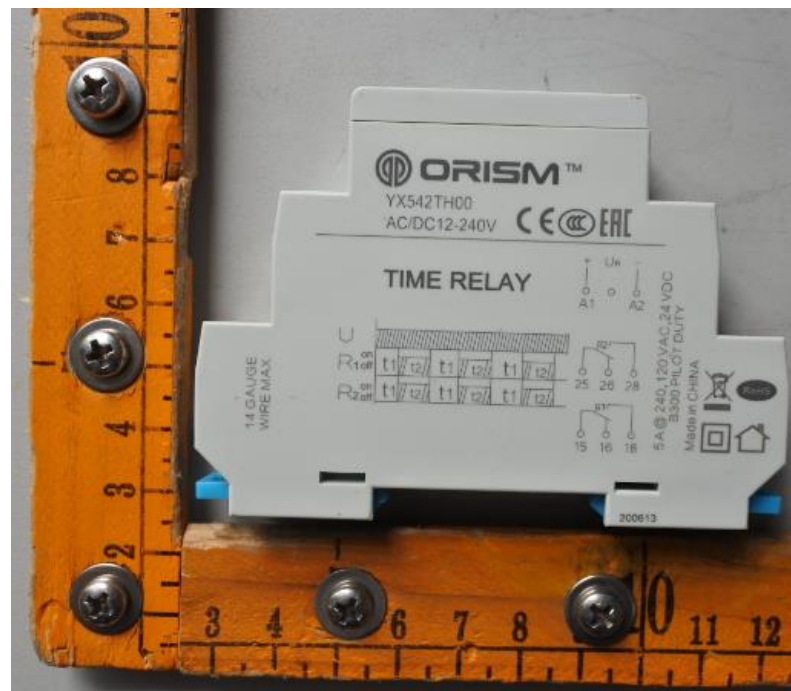


Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

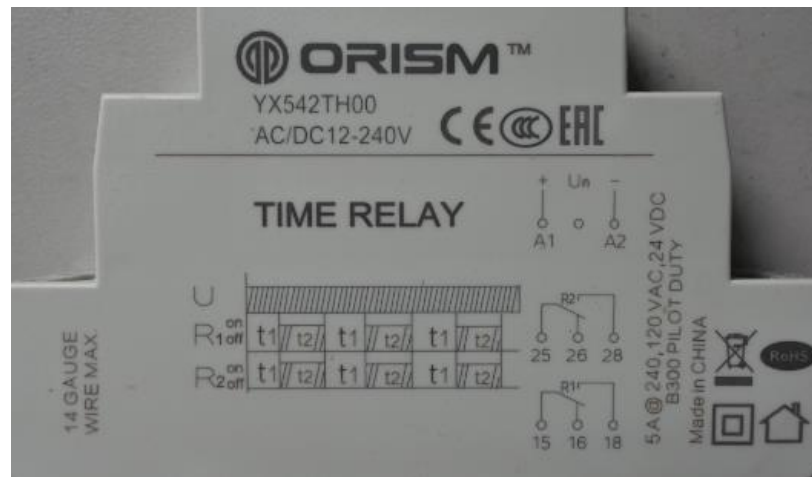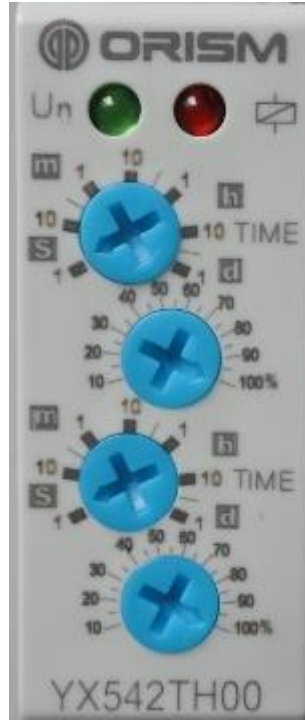

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

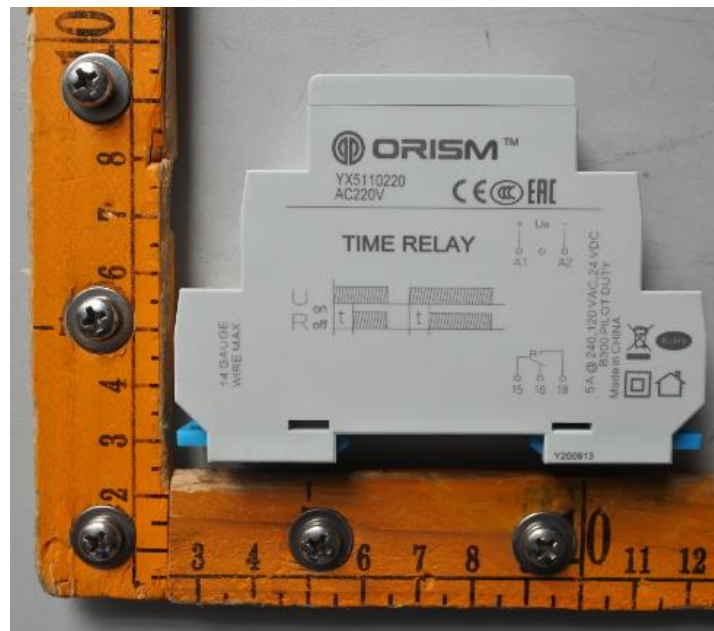



Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.





Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBS that own these marks.

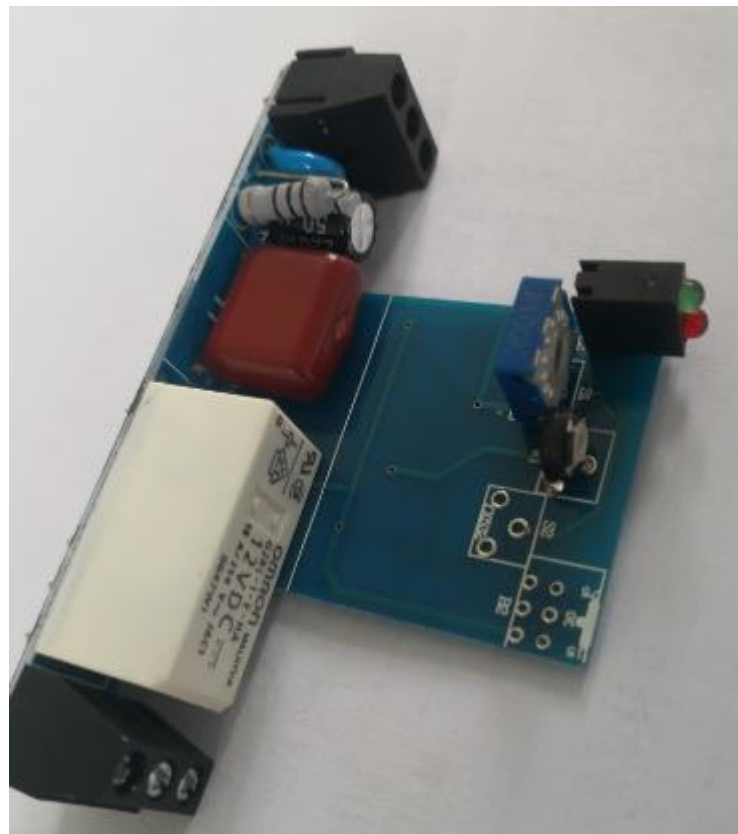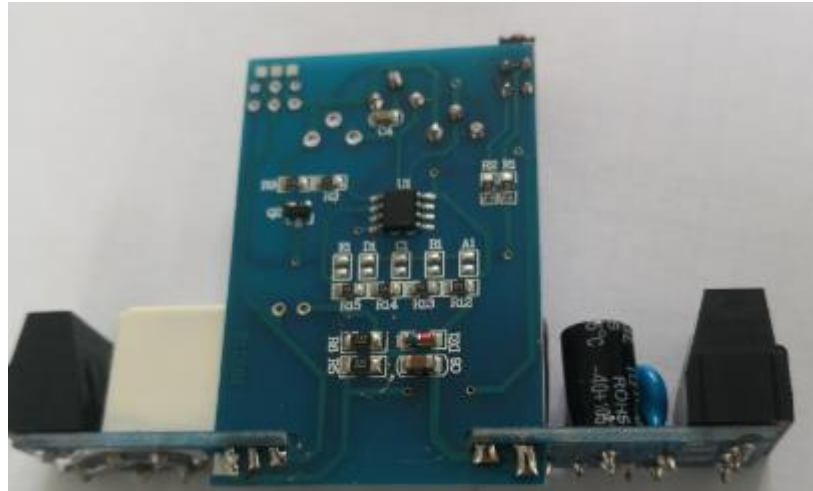

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

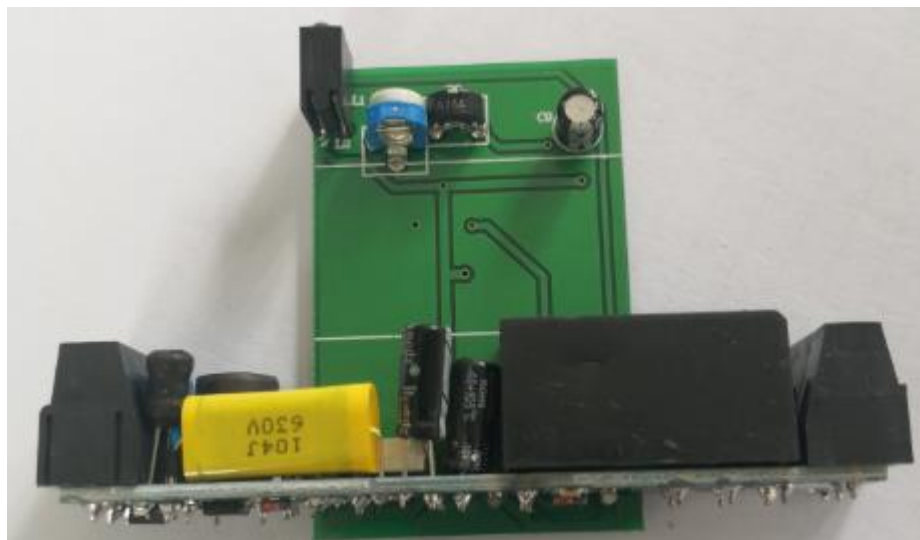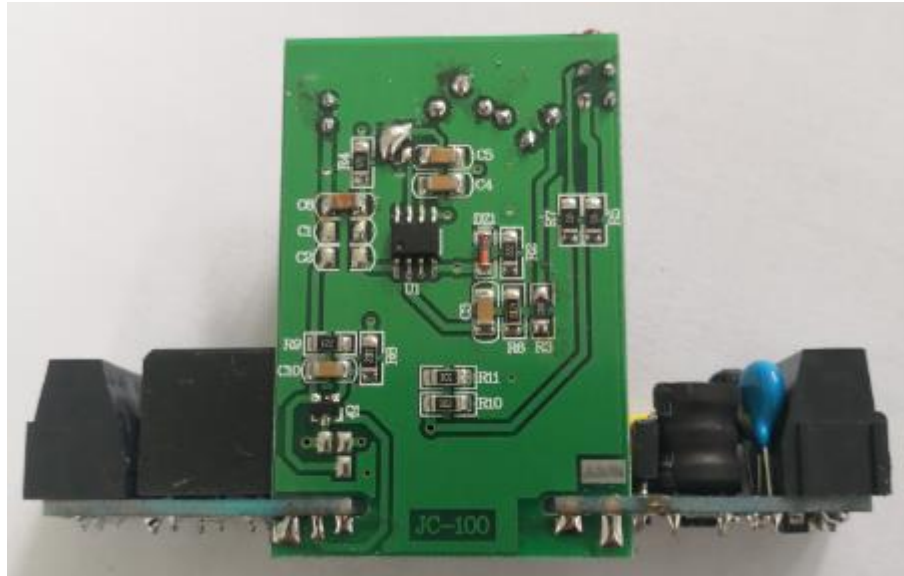

| | |
|--|--|
| Test item particulars | |
| Classification of installation and use | Screw-in type |
| Supply Connection..... | Screw-in connection |
| Kind of control circuit device..... | <input type="checkbox"/> manual control switches, e.g. push-buttons, rotary switches, foot switches, etc. <input checked="" type="checkbox"/> electromagnetically operated control switches, either time delayed or instantaneous, e.g. contactor relays <input type="checkbox"/> pilot switches, e.g. pressure switches, temperature sensitive switches (thermostats) <input type="checkbox"/> position switches <input type="checkbox"/> associated control equipment, e.g. indicator lights, etc. |
| Kind of switching elements | <input type="checkbox"/> auxiliary contacts of a switching device (e.g. contactor, circuit-breaker, etc) which are not dedicated exclusively for use with the coil of that device <input type="checkbox"/> interlocking contacts of enclosure doors <input type="checkbox"/> control circuit contacts of rotary switches <input type="checkbox"/> control circuit contacts of overload relays |
| Number of poles..... | Form C |
| Kind of current..... | <input checked="" type="checkbox"/> ac and/or <input checked="" type="checkbox"/> dc |
| Interrupting medium..... | <input checked="" type="checkbox"/> air, <input type="checkbox"/> oil, <input type="checkbox"/> gas, <input type="checkbox"/> vacuum, <input type="checkbox"/> ... |
| Operating conditions | |
| Method of operations | <input type="checkbox"/> manual <input type="checkbox"/> electromagnetic <input type="checkbox"/> pneumatic <input type="checkbox"/> electro-pneumatic |
| Method of control | <input type="checkbox"/> automatic <input type="checkbox"/> non-automatic <input type="checkbox"/> semi-automatic |

Rated and limiting values for switching elements:

Voltages:

- rated operational voltage U_e (V): AC-15: U_e/I_e :240V/5A,120V/5A;
DC-13: U_e/I_e :24V/5A
- rated insulation voltage U_i (V): 300V
- rated impulse withstand voltage U_{imp} (kV): 2.5kV

Currents:

- conventional free air thermal current I_{th} (A): 5A
- conventional enclosed thermal current I_{the} (A).....: N/A
- rated operational current I_e (A): AC-15: U_e/I_e :240V/5A,120V/5A;
DC-13: U_e/I_e :24V/5A

Rated frequency (Hz).....: 50Hz

Utilization category.....: AC-15,DC-13

Short-circuit characteristic:

- rated conditional short-circuit current (kA): 1kA
- kind of protective device: RT14-20 6A

Electrically separated contact elements.....: N/A

Actuating quantities for pilot switches: N/A

Pilot switches having two or more contact elements...: N/A

Indication of contact elements of same polarity.....: N/A

IP code, in case of an enclosed control device: N/A

Pollution degree: 3


Suitability for isolation, with the symbol 07-13-06 of
IEC 60617-7: N/A


| | |
|---|--|
| Possible test case verdicts: | |
| - test case does not apply to the test object : N/A | |
| - test object does meet the requirement : P (Pass) | |
| - test object does not meet the requirement : F (Fail) | |
| Testing..... : | |
| Date of receipt of test item..... : 2022-07-23 | |
| Date (s) of performance of tests..... : 2022-07-23~2022-08-05 | |
| General remarks: | |
| "(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. | |
| Throughout this report a <input type="checkbox"/> comma / <input checked="" type="checkbox"/> point is used as the decimal separator. | |
| Manufacturer's Declaration per sub-clause 4.2.5 of IEC60947-5-1: | |
| The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided | <input type="checkbox"/> Yes <input checked="" type="checkbox"/> Not applicable |
| When differences exist; they shall be identified in the General product information section. | |
| Name and address of factory (ies) : WENZHO DERREK ELECTRIC CO.,LTD/ Floor 5, Jianghua insulation, Zhiguang Industry Zone, Liushi Town, Wenzhou City, Zhejiang Province, China | |
| General product information: | |
| YX series | |
| Ui:300V; | |
| Uimp:2.5kV; | |
| Ith:5A; | |
| AC-15:Ue/Ie:240V/5A,120V/5A; | |
| DC-13:Ue/Ie:24V/5A | |
| Us: | |
| AC/DC12-240V(YX5 <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> H00) | |
| AC220V(Other types) | |

Description of Sample Type:

YX 5
1 2 3 4 5 6

- 1 Model series
- 2 Design serial number
- 3 Number of adjustable knobs: 1、2、3、4
- 4 Number of output contact group: 1、2
- 5 Parameters: 0: single delay output; T: Multi-period delay output; A: 1S/10S/1M/10M ...
- 6 Output voltage: 220: AC220V; H00: AC/DC12-240V ...

| IEC 60947-5-1 | | | |
|---------------|---|---|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 5 | PRODUCT INFORMATION | | |
| 5.2 | Marking | | |
| | Data shall be preferably marked on the equipment: | | |
| | a - manufacturer's name or trademark |  | P |
| | b - type designation or serial number | YX5110220 | P |
| | Data shall be included on the nameplate, or on the equipment, or in the manufacturer's published literature: | | |
| | c - number of this standard | | N/A |
| | d - rated operational voltages | AC220V | P |
| | e - utilization category and rated operational currents, at the rated operational voltages of the control circuit device | | N/A |
| | f - rated insulation voltage: | | N/A |
| | g - rated impulse withstand voltage | | N/A |
| | h - vacant | | N/A |
| | i - IP code, in case of enclosed control circuit device | | N/A |
| | j - pollution degree | | N/A |
| | k - type and maximum ratings of short-circuit protective device | | N/A |
| | l - conditional short-circuit current | | N/A |
| | m - suitability for isolation, where applicable, with the symbol S00288 of IEC 60617 | | P |
| | n - indication of contact elements of same polarity | | N/A |
| | Marking of data under n) shall be included on the nameplate of the control circuit device in order to ensure proper wiring at installation. | | N/A |
| | o) length of insulation to be removed before insertion of the conductor into the terminal. | | N/A |
| | p) for non-universal screwless terminals: <ul style="list-style-type: none"> – "s" or "sol" for terminals declared for rigid-solid conductors; – "r" for terminals declared for rigid (solid and stranded) conductors; – "f" for terminals declared for flexible conductors. | | N/A |

| IEC 60947-5-1 | | | |
|---------------|---|--|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | The indication "s", "sol", "r" or "f" for non-universal screwless terminals shall be marked on the device or, if the space available is not sufficient, on the smallest package unit or in technical information provided with the product. | | N/A |
| 5.2.2 | Terminal identification and marking (see 7.1.8.4 of IEC 60947-1) | | |
| | Clearly and permanently identified according IEC 60445 and Annex L, unless superseded by relevant standard. |  | P |
| | Neutral terminal identified by letter | | N/A |
| | Protective earth terminal identified by letter | | N/A |
| 5.2.3 | Functional markings | | |
| | Actuators may be identified by symbols in the form of engravings, but if a stop button carries any symbol engraved or marked this symbol shall be a circle or oval | | N/A |
| | Letters or words may used where space is available | | N/A |
| | Symbols shall be in accordance with IEC 60417 | | N/A |
| 5.2.4 | Emergency stop | | |
| | Actuator shape and colour, background colour and direction of unlatching for emergency stop devices with mechanical latching function shall be in accordance with 4.2 of IEC 60947-5-5 | | N/A |
| 5.2.5 | Operating diagram | | |
| 5.2.5.1 | General | | |
| | As rotary switches may have multiplicity of contacts elements and a multiplicity of actuator positions, it necessary that the manufacturer indicates the relationship between the actuator positions and the associated contact elements position | | N/A |
| 5.2.5.2 | Position indication and contact position | | |
| | Sub clause 7.1.6.1 of IEC 60947-1 applies | | N/A |
| | The position indication shall be clear, and the associated text or symbols shall be indelible and easily legible | | P |
| 5.2.5.3 | Terminal markings for operating diagrams | | |
| | Terminal markings shall be clearly identifiable with respect to the operating diagram (see also Annex M) | | P |
| 5.2.6 | Time delay markings | | |

| IEC 60947-5-1 | | | |
|---------------|---|--|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | The manufacturer shall indicate, for each time-delay contact element, the characteristic of the delay, according to 2.4.1.1 or 2.4.1.2 | 1s~10s | P |
| 5.3 | Instructions for installation, operation and maintenance | | |
| | The manufacture shall specify, in his documents or catalogues: | | |
| | - the conditions for installation, operation and maintenance, if any, of the equipment during operation and after a fault | | N/A |
| | - the specify the measures to be taken with regard to EMC, if any, | | N/A |
| | - equipment only suitable in environment A shall provided with the following notice | This product has been designed for environment B may cause unwanted electromagnetic disturbances in which case the user may be required to take adequate mitigation measures. | N/A |
| | - if necessary, the instructions for transport, installation and operation of the equipment shall indicate the measures that are particular importance for the proper and correct installation, commissioning and operation of the equipment. | | N/A |

| IEC 60947-5-1 | | | |
|---------------|--|--------------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 6 | Normal service, mounting and transport conditions | | |
| 6.1.1 | Ambient temperature | | |
| | Ambient air temperature does not exceed +40 °C and its average over 24 hours does not exceed +35°C and the lower limit is -5°C | | P |
| 6.1.2 | Altitude | | |
| | Altitude of side of installation does not exceed 2000m | | P |
| 6.1.3 | Atmospheric conditions | | |
| 6.1.3.1 | Relative humidity does not exceed 50 % at max temp +40 °C, higher rel. hum may at lower temperatures e.g. 90% at +20 °C | | P |
| 6.1.3.2 | Pollution degree | | |
| | Unless otherwise stated, equipment for: - industrial use shall have a degree 3, depending upon micro-environment - household and similar shall have degree 2 | 3 | P |
| 6.1.4 | Shock and vibration | | |
| | Under consideration | | |
| 6.2 | Conditions during transport and storage | | |
| | Under consideration | | |
| 6.3 | Mounting | | |
| | According manufacturer's instruction | See manufacturer's instruction | N/A |
| 6.3.1 | Mounting of single hole mounted devices | | |
| | Dimensions according Table 2 | | N/A |
| 6.3.1.1 | Location of key recess (if any) | | |
| | Dimensions according Table 3 | | N/A |
| 6.3.1.2 | Range of panel thickness | | |
| | The device shall be capable of being mounted on any thickness between 1 and 6 mm | | N/A |
| 6.3.1.3 | Grouping of devices | | |
| | The distances a between the mounting centres in the same row and b between the centre lines of the rows shall be not less than those given in table 3. Distances a and b may be interchanged | | N/A |

| IEC 60947-5-1 | | | |
|---------------|---|---------------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 7 | CONSTRUCTIONAL AND PERFORMANCE REQUIREMENTS | | |
| 7.1 | Constructional requirements | | |
| 7.1.1 | General | | |
| | Sub clause 7.1 of IEC 60947-1 applies except for 7.1.2, 7.1.3, 7.1.7, 7.1.9 and 7.1.13, and with the following additions: | | P |
| 7.1.2 | Materials | | |
| 7.1.2.2 | Glow-wire testing | | |
| | | +960±15°C(ABS) +960±15°C(PC) | P |
| 7.1.2.3 | Test based on flammability category | | |
| | | See Table | N/A |
| 7.1.3 | Current-carrying parts and their connection | | |
| | No contact pressure through insulating materials | | P |
| 7.1.4 | Clearances and creepage distances | | |
| | Clause 7.1.4 of IEC 60947-1 applies | | |
| | Clearances | | |
| | Minimum values are given in Table 13 and Table 15 of IEC 60947-1 | | |
| | Rated impulse withstand voltage | See test sequence I | |
| | Minimum clearance - Case B (mm) | | |
| | Minimum clearance - Case A (mm) | | |
| | Measured clearances (mm) | | N/A |
| | Creepage distances | | |
| | Pollution degree | 3 | |
| | Comparative tracking index (V) | 175 | |
| | Material group | IIIa | |
| | Rated insulation voltage Ui (V) | 300V | |
| | Minimum creepage distances (mm) | | |
| | Measured creepage distances (mm) | | N/A |
| 7.1.5 | Actuator | | |
| 7.1.5.1 | Insulation | | |
| | Clause 7.1.5.1 of IEC 60947-1 applies | | N/A |
| 7.1.5.2 | Direction | | |
| | Clause 7.1.5.2 of IEC 60947-1 applies | | N/A |

| IEC 60947-5-1 | | | |
|---------------|---|---------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 7.1.5.3 | Actuating force (or moment) | | |
| | | See test sequence V | N/A |
| 7.1.5.4 | Limitation of rotation (of rotary switch) | | |
| | When actuators with limited or unidirectional movement are used, they shall be fitted with robust means of limitation, capable of withstanding five times the actual maximum actuating moment. | | N/A |
| 7.1.5.5 | Emergency stop | | |
| | The actuator shall preferably latch in the actuated position with the control contact open. This latching shall be released by a separate action, e.g. by pulling, rotation, or by means of a key. | | N/A |
| 7.1.6 | Indication of the contact position | | |
| | Clause 7.1.6 of IEC 60947-1 applies | | N/A |
| 7.1.7 | Conditions for control switches suitable for isolation | | |
| | A control switch suitable for isolation shall be manually operated with a direct opening action (see Annex K) and shall comply with the isolating function in the open position (see 2.1.19 and 7.1.7 of IEC 60947-1). | | N/A |
| | The open position of a control switch suitable for isolation shall be a position in which the switch can remain when no actuating force is applied. | | N/A |
| | In order to avoid unintentional reclosing, it shall be possible to prevent the operation of the control switches suitable for isolation when the contact elements are in the open position. This may be obtained by padlocking or by a latch which shall only be releasable by a special tool or key. | | N/A |
| 7.1.8 | Terminals | | |
| | | See clause 8.2.4 | P |
| 7.1.10 | Provisions for protective earthing | | |
| | Clause 7.1.10 of IEC 60947-1 applies | | N/A |
| 7.1.11 | Enclosures for equipment | | |
| | Clause 7.1.11 of IEC 60947-1 applies | | N/A |
| 7.1.12 | Degree of protection of enclosed equipment | | |
| | Degree of protection : IP | | |
| | Test for first characteristic | | |

| IEC 60947-5-1 | | | |
|---------------|--|--|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | Test for first numeral : | <input type="checkbox"/> 1: <input type="checkbox"/> 2: <input type="checkbox"/> 3: <input type="checkbox"/> 4: <input type="checkbox"/> 5: <input type="checkbox"/> 6: | N/A |
| | Test for second characteristic | | |
| | Test for second numeral : | <input type="checkbox"/> 1: <input type="checkbox"/> 2: <input type="checkbox"/> 3: <input type="checkbox"/> 4: <input type="checkbox"/> 5: <input type="checkbox"/> 6: <input type="checkbox"/> 7: <input type="checkbox"/> 8: | N/A |
| 7.1.14 | Class II control circuit devices | | |
| | These devices shall not be provided with means for protective earthing (see IEC 61140) | | N/A |
| | For class II control circuit devices insulated by encapsulation, see Annex F | See annex F | N/A |
| 7.1.15 | Requirements for control devices with integrally connected cables | | |
| | | See annex G | N/A |
| 7.2 | Performance requirements | | |
| | Subclauses 7.2.1.1 and 7.2.2 of IEC 60947-1 apply with the following additions: | | N/A |
| 7.2.1.2 | Limits of operation of contactor relays | | |
| | The limits of operation for contactor relays shall be in accordance with IEC 60947-4-1 | See clause 8.3.3.2 | N/A |
| 7.2.3 | Dielectric properties | | |
| | Subclause 7.2.3 of IEC 60947-1 applies with the following addition | See clause 8.3.3.4 | P |
| | For class II control circuit devices insulated by encapsulation | See Annex F | N/A |
| 7.2.4 | Ability to make and break under normal and abnormal load conditions | | |
| 7.2.4.1 | Making and breaking capacities | | |
| | Making and breaking capacities under normal conditions as state in table 4 | See clause 8.3.3.5.3 | P |
| | Making and breaking capacities under abnormal conditions as state in table 5 | See clause 8.3.3.5.4 | P |
| 7.2.4.3 | Durability | | |

| IEC 60947-5-1 | | | |
|---------------|---|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | Sub-clause 7.2.4.3 of IEC 60947-1 applies with the following additions: | | |
| | Mechanical durability | See Annex C | N/A |
| | Electrical durability | See Annex C | N/A |
| 7.2.5 | Conditional short-circuit current | | |
| | The switching element shall withstand the stresses resulting from short-circuit current under the conditions specified in 8.3.4 | | P |
| 7.2.7 | Additional requirements for control switches suitable for isolation | | |
| | Control switches suitable for isolation shall be tested according to 8.3.3.4 of IEC 60947-1 with a value of test voltage as specified in Table 14 or IEC 60947-1 corresponding to the rated impulse withstand voltage U_{imp} declared by the manufacturer. | | N/A |
| | Other additional requirements applicable to such control switches are under consideration | | |
| 7.2.8 | Maximum recovery time | | |
| | For equipment incorporating electronic circuits the maximum recovery time and the measuring method shall be stated by the manufacturer | | N/A |
| 7.3 | Electromagnetic compatibility (EMC) | | |
| | Subclause 7.3 of IEC 60947-1 applies with the following additions: | | N/A |
| | The control circuit device to be tested shall have all the essential design details of the type which it represents and shall be in a clean and new condition. | | N/A |
| | The EMC tests shall be conducted at rated operational voltage U_e , or if the rated operational voltage is given as a range, then the test shall be conducted at a voltage which represents the worst case condition. | | N/A |
| | Maintenance or replacement of parts during or after a testing cycle is not permitted. | | N/A |
| | The products covered by this standard are intended for use in environment A. | | N/A |
| | Contactors incorporating electronic circuits shall follow the requirements of 8.3.2.2 of IEC 60947-4-1 | | N/A |

| IEC 60947-5-1 | | | |
|---------------|--|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE I (sample No. 1 YX542AH00) | | |
| Test No. 1 | - operating limits of contactor relays (8.3.3.2) | | |
| Test No. 2 | - temperature rise (Clause 8.3.3.3.) | | |
| Test No. 3 | - dielectric properties (Clause 8.3.3.4) | | |
| Test No. 4 | - mechanical properties of terminals (8.2.4 of IEC 60947-1) | | |
| 8.3.3.2 | Operating limits of contactor relays | | |
| 8.3.3.2.1 | Power-operated equipment: | | |
| 8.2.1.2.1 | Electromagnetic contactors and starters | | |
| | rated control supply voltage U_s (V) | | |
| | frequency (Hz) | | |
| | declared ambient temperature(>40 °C) for 100% U_s | | |
| | limits of close satisfactorily at any value between 85% and 110% of rated control supply voltage U_s . : | | N/A |
| | limits of drop out and open fully are: 75% to 20% for a.c. and 75% to 10% for d.c. : | | N/A |
| | ambient temperature(-5 °C) for 100% U_s | | |
| | limits of close satisfactorily at any value between 85% and 110% of rated control supply voltage U_s . : | | N/A |
| | Limits of drop out and open fully are: 75% to 20% for a.c. and 75% to 10% for d.c. : | | N/A |
| 8.2.1.2.2 | Contactors and starters with electronically controlled electromagnet | | |
| | Rated control supply voltage U_s (V) | | |
| | Frequency (Hz) | | |
| | Declared ambient temperature(>40 °C) for 100% U_s | | |
| | Limits of close satisfactorily at any value between 85% and 110% of rated control supply voltage U_s . : | | N/A |
| | Limits of drop out and open fully are: 75% to 20% for a.c. and 75% to 10% for d.c. : | | N/A |
| | Ambient temperature(-5 °C) for 100% U_s | | |
| | Limits of close satisfactorily at any value between 85% and 110% of rated control supply voltage U_s . : | | N/A |
| | Limits of drop out and open fully are: 75% to 20% for a.c. and 75% to 10% for d.c. : | | N/A |
| 8.2.1.2.3 | Electro-pneumatic contactors and starters | | |
| | Rated air supply pressure(Bar) | | |

| IEC 60947-5-1 | | | |
|---------------|---|------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | Declared ambient temperature(>40 °C) for 100% of the rated air supply pressure(Bar) | | |
| | Limits of close satisfactorily at any value between 85% and 110% of rated air supply pressure(Bar) .. : | | N/A |
| | Limits of drop out and open fully are: 75% to 10% of rated air supply pressure(Bar) .. : .. : | | N/A |
| | Ambient temperature(-5 °C) for 100% of the rated air supply pressure(Bar) | | |
| | Limits of close satisfactorily at any value between 85% and 110% of rated air supply pressure(Bar) .. : | | N/A |
| | Limits of drop out and open fully are: 75% to 10% for the rated air supply pressure(Bar) .. : .. : | | N/A |
| 8.3.3.3 | Temperature rise | | |
| | ambient temperature 10-40 °C .. : .. : | +25°C | |
| | test enclosure W x H x D (mm x mm x mm) .. : .. : | | |
| | material of enclosure .. : .. : | | |
| | NO-contacts, test conditions: | | |
| | - rated operational current I _e (A) .. : .. : | 5A | P |
| | - cable cross-section (mm ²) .. : .. : | 1.0 | P |
| | - cable length (m) .. : .. : | 1 | P |
| | - temperature rise of NO terminals (K) .. : .. : | See table Heating Test | P |
| | NC-contacts, test conditions: | | |
| | - rated operational current I _e (A) .. : .. : | | N/A |
| | - cable cross-section (mm ²) .. : .. : | | N/A |
| | - cable length (m) .. : .. : | | N/A |
| | - temperature rise of NC terminals (K) .. : .. : | See table | N/A |
| | Coils and electromagnets, test conditions: | | |
| | - rated control supply voltage U _s (V / Hz) .. : .. : | | N/A |
| | - Class of insulating material .. : .. : | | N/A |
| | - temperature rise of coil and electromagnets (K) .. : .. : | See table | N/A |
| 8.3.3.4 | Dielectric properties | | |
| | Test of dielectric properties, impulse withstand voltage (U _{imp} indicated): | | |
| | - verification by measurement of clearances instead of testing | | P |
| | - rated impulse withstand voltage (V) .. : .. : | 2.5kV | P |
| | - test U _{imp} auxiliary circuits (kV) .. : .. : | 2.98kV | P |
| | Test of dielectric properties, dielectric withstand voltage (U _{imp} not indicated): | | |
| | - rated insulation voltage (V) .. : .. : | 300V | P |

| IEC 60947-5-1 | | | |
|---------------|---|------------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | - control and auxiliary circuits, test voltage (V) for 60 sec | $1.50 \times 10^3 \text{V}$ | P |
| 8.2.4 | Mechanical and electrical properties of terminals | | |
| 8.2.4.2 | Mechanical strength of terminals | | |
| | maximum cross-sectional area of conductor (mm ²) : | 1.00 mm ² (rigid) | P |
| | diameter of thread (mm) | M2.5 | P |
| | torque (Nm) | 0.44Nm | P |
| | 5 times on 2 separate clamping units | | P |
| 8.2.4.3 | Testing for damage to and accidental loosening of conductor (flexion test) | | |
| | conductor of the smallest cross-sectional area (mm ²) | 0.50mm ² (rigid) | P |
| | number of conductor of the smallest cross section .. : | 2 | P |
| | diameter of bushing hole (mm) | 6.5mm | P |
| | height between the equipment and the platen (mm) | 260mm | P |
| | mass at the conductor(s) (kg) | 0.3kg | P |
| | 135 continuous revolutions: the conductor shall neither slip out of the terminal nor break near the clamping unit | | P |
| 8.2.4.4 | Pull-out test | | |
| | force (N) | 20.0N | P |
| | 1 min, the conductor shall neither slip out of the terminal nor break near the clamping unit | | P |
| 8.2.4.3 | Flexion test | | |
| | conductor of the largest cross-sectional area (mm ²) : | 1.00mm ² (rigid) | P |
| | number of conductor of the largest cross-section ... : | 1 | P |
| | diameter of bushing hole (mm) | 6.5mm | P |
| | height between the equipment and the platen (mm) | 260mm | P |
| | mass at the conductor(s) (kg) | 0.4kg | P |
| | 135 continuous revolutions: the conductor shall neither slip out of the terminal nor break near the clamping unit | | P |
| 8.2.4.4 | Pull-out test | | |
| | force (N) | 35.0N | P |
| | 1 min, the conductor shall neither slip out of the terminal nor break near the clamping unit | | P |
| 8.2.4.3 | Flexion test | | |

| IEC 60947-5-1 | | | |
|---------------|---|---|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | conductor of the largest and smallest cross-sectional area (mm ²) | 1.00mm ² (rigid)/0.50mm ² (rigid) | P |
| | number of conductor of the smallest cross sectional, number of conductor of the largest cross sectional . : | 1/1 | P |
| | diameter of bushing hole (mm) | 6.5mm/6.5mm | P |
| | height between the equipment and the platen (mm) | 260mm/260mm | P |
| | mass at the conductor(s) (kg) | 0.4kg/0.3kg | P |
| | 135 continuous revolutions: the conductor shall neither slip out of the terminal nor break near the clamping unit | | P |
| 8.2.4.4 | Pull-out test | | |
| | force (N) | 35.0N/20.0N | P |
| | 1 min, the conductor shall neither slip out of the terminal nor break near the clamping unit | | N/A |
| 8.2.4.5 | Test for insertability of unprepared round copper conductors having the maximum cross-section | | |
| | The test shall be carried out using the appropriate gauge form A or form B specified in Table 7. | | P |
| | The measuring section of the gauge shall be able to penetrate freely into the terminal aperture to the full depth of the terminal (see also note to Table 7). | | P |
| | Alternatively, the test can be carried out by inserting the largest conductor of type and rated cross-section among those recommended by the manufacturer, the diameter of which corresponds to the theoretical diameter according to Table 7a, after the insulation has been removed and the end has been reshaped. The stripped end of the conductor shall be able to enter completely within the clamping unit aperture, without use of undue force. | | P |
| 8.2.4.7 | Electrical performance of screwless-type clamping units | | |
| | If terminals are used which are qualified according to IEC 60999-1 and the operating conditions of the terminals in the device are according to the operating conditions specified by the manufacturer of the terminals, then the test does not need to be performed. | | N/A |
| | Sub clause 8.2.4.7 of IEC 60947-1 applies with the following changes: | | N/A |

| IEC 60947-5-1 | | | |
|---------------|---|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | <ul style="list-style-type: none"> – The test shall be done on the connecting device equipped with the clamping units; – The number of specimens shall be at least 8; – The test shall be done as a single 8 test: <ul style="list-style-type: none"> • Eight clamping units shall be tested to the declared voltage drop; • If the number of failed clamping units does not exceed two, the test is considered passed. | | N/A |
| | test current (A) | | N/A |
| | voltage drop < 15 mV. (V) | | N/A |
| 8.2.4.8 | Ageing test for screwless-type clamping units | | |
| | If terminals are used which are qualified according to IEC 60999-1 and the operating conditions of the terminals in the device are according to the operating conditions specified by the manufacturer of the terminals, then the test does not need to be performed. | | N/A |
| | Subclause 8.2.4.8 of IEC 60947-1 applies with the following changes: | | N/A |
| | The test shall be done on the connecting device equipped with the clamping units. | | N/A |
| | test current (A) | | N/A |
| | maximum temperature for the temperature cycles shall be 40°C. Max. temperature (°C) | | N/A |
| | voltage drop ≤ 22,5 mV or 1,5 times the value measured after the 24th cycle. (V) | | N/A |

| IEC 60947-5-1 | | | |
|---------------|---|---------------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE II (sample No. 2 YX511) | | |
| Test No. 1 | - Making and breaking capacities of switching elements under normal conditions (8.3.3.5.3) | | |
| Test No. 2 | - Dielectric verification (8.3.3.5.6.b) | | |
| 8.3.3.5.3 | Making and breaking capacities of switching elements under normal conditions | | |
| | contact element (figure / form) | C | |
| | contact polarity..... | - | |
| | utilization category (AC / DC)..... | AC-15 | |
| | rated operational voltage Ue (V) | 240V | |
| | rated operational current Ie (A) or power (kW) | 5A | |
| No.1 | - test voltage U/Ue = 1,1 (V) | L1: 266V L2: - L3: - | P |
| | - power factor/time constant | L1: 0.32/0.31 L2: - L3: - | P |
| | - make operations: test current I/Ie (A) | L1: 55.2 L2: - L3: - | P |
| | - break operations: test current I/Ie (A) | L1: 5.52 L2: - L3: - | P |
| | - a.c. test: Inductor shunted by a resistor taking 3% of the total power consumed - d.c. test: test current increase from zero to steady-state value within limits of figure 9 | | P |
| | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 6 | P |
| | - number of operating cycles | 50 | P |
| | - test voltage U/Ue = 1,0 (V) | L1: 242V L2: - L3: - | P |
| | - power factor/time constant | L1: 0.32/0.31 L2: - L3: - | P |

| IEC 60947-5-1 | | | |
|---------------|--|----------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | - make operations: test current I/le (A) | L1: 50.2 L2: - L3: - | P |
| | - break operations: test current I/le (A) | L1: 5.02 L2: - L3: - | P |
| No. 2 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | Rapidly | P |
| | - number of operating cycles | 10 | P |
| No. 3 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 60 | P |
| | - number of operating cycles | 990 | P |
| No. 4 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 6 | P |
| | - number of operating cycles | 5000 | P |
| | Behaviour and condition during and after the test: | | |
| | - no electrical or mechanical failures | | P |
| | - no contact welding or prolonged arcing | | P |
| | - no blowing of the fusible element in the earth circuit | | P |
| 8.3.3.5.6.b | Dielectric verification: | | |
| | dielectric test voltage (V) 2 xUe with a min.of 1000V: | 1.00×10^3V | P |

| IEC 60947-5-1 | | | |
|---------------|---|-----------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE II (sample No. 3 YX511) | | |
| Test No. 1 | - Making and breaking capacities of switching elements under normal conditions (8.3.3.5.3) | | |
| Test No. 2 | - Dielectric verification (8.3.3.5.6.b) | | |
| 8.3.3.5.3 | Making and breaking capacities of switching elements under normal conditions | | |
| | contact element (figure / form) | C | |
| | contact polarity..... | - | |
| | utilization category (AC / DC)..... | DC-13 | |
| | rated operational voltage Ue (V) | 24V | |
| | rated operational current Ie (A) or power (kW) | 15A | |
| No.1 | - test voltage U/Ue = 1,1 (V) | L1: 26.6V L2: - L3: - | P |
| | - power factor/time constant | L1: 301 L2: - L3: - | P |
| | - make operations: test current I/Ie (A) | L1: 16.6 L2: - L3: - | P |
| | - break operations: test current I/Ie (A) | L1: 16.6 L2: - L3: - | P |
| | - a.c. test: Inductor shunted by a resistor taking 3% of the total power consumed - d.c. test: test current increase from zero to steady-state value within limits of figure 9 | | P |
| | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 6 | P |
| | - number of operating cycles | 50 | P |
| | - test voltage U/Ue = 1,0 (V) | L1: 24.2V L2: - L3: - | P |
| | - power factor/time constant | L1: 301 L2: - L3: - | P |

| IEC 60947-5-1 | | | |
|---------------|--|----------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | - make operations: test current I/le (A) | L1: 15.1 L2: - L3: - | P |
| | - break operations: test current I/le (A) | L1: 15.1 L2: - L3: - | P |
| No. 2 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | Rapidly | P |
| | - number of operating cycles | 10 | P |
| No. 3 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 60 | P |
| | - number of operating cycles | 990 | P |
| No. 4 | - on-time (ms) | >50ms | P |
| | - operating cycles per minute | 6 | P |
| | - number of operating cycles | 5000 | P |
| | Behaviour and condition during and after the test: | | |
| | - no electrical or mechanical failures | | P |
| | - no contact welding or prolonged arcing | | P |
| | - no blowing of the fusible element in the earth circuit | | P |
| 8.3.3.5.6.b | Dielectric verification: | | |
| | dielectric test voltage (V) 2 xUe with a min.of 1000V: | 1.00×10^3V | P |

| IEC 60947-5-1 | | | |
|---------------|---|----------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE III (sample No. 4 YX511) | | |
| Test No. 1 | - Making and breaking capacities of switching elements under abnormal conditions (8.3.3.5.4) | | |
| Test No. 2 | - Dielectric verification (8.3.3.5.6.b) | | |
| 8.3.3.5.4 | Making and breaking capacities of switching elements under abnormal conditions: | | |
| | contact element (figure / form) | C | |
| | contact polarity | - | |
| | utilization category (AC / DC) | AC-15 | |
| | rated operational voltage Ue (V) | 240V | |
| | rated operational current Ie (A) or power (kW) | 5A | |
| | Conditions, make/break operations: | | |
| | - test voltage U/Ue = 1,1 (V) | L1: 266V L2: - L3: - | P |
| | - power factor/time constant | L1: 0.31 L2: - L3: - | P |
| | - make operations: test current I/Ie (A) | L1: 50.2 L2: - L3: - | P |
| | - break operations: test current I/Ie (A) | L1: 50.2 L2: - L3: - | P |
| | - a.c. test: Inductor shunted by a resistor taking 3% of the total power consumed - d.c. test: test current increase from zero to steady-state value within limits of figure 9 | | P |
| | - on-time (ms) | >50 ms | P |
| | - operating cycles per minute | 6 | P |
| | - number of operating cycles | 10 | P |
| | Behaviour and condition during and after the test: | | |
| | - no electrical or mechanical failures | | P |
| | - no contact welding or prolonged arcing | | P |
| | - no blowing of the fusible element in the earth circuit | | P |
| 8.3.3.5.6.b | Dielectric verification: | | |
| | dielectric test voltage (V) 2 xUe with min.of 1000V .. | 1.00 × 10 ³ V | P |

| IEC 60947-5-1 | | | |
|---------------|--|------------------------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE IV (sample No. 5 YX511) | | |
| Test No. 1 | - Performance under conditional short-circuit current (8.3.4) | | |
| Test No. 2 | - Dielectric verification (8.3.3.5.6.b) | | |
| 8.3.4 | Performance under conditional short-circuit current | | |
| | contact element (figure / form) | C | |
| | contact polarity..... | | |
| | type of SCPD | RT14-20 6A | |
| | ratings of SCPD (A / V) | | |
| | prospective current (kA) | 1kA | |
| | test voltage (V) $U/U_e = 1,1$ (V) | 266V | P |
| | r.m.s. test current obtained (kA) | 1.03kA | P |
| | power factor (max. 0,7) | 0.67 | P |
| | first CO operation by closing the separate making switch: test I_p / I^2dt (kA / kA ² s) | L1:425A /164A ² s | P |
| | time interval between test (min. 3 min) | 3min | P |
| | second CO operation by closing the separate making switch: test I_p / I^2dt (kA / kA ² s) | L2:260A /144A ² s | P |
| | time interval between test (min. 3 min) | 3min | P |
| | third making operation to closed switching elements: test I_p / I^2dt (kA / kA ² s) | L3:434A /183A ² s | P |
| | Behaviour of the equipment during the test: | | |
| | switching elements open by the normal actuating system | | P |
| 8.3.3.5.6.b | Dielectric verification: | | |
| | dielectric test voltage (V) $2 \times U_e$ with min.of 1000V .. | 1.00×10^3V | P |

| IEC 60947-5-1 | | | |
|---------------|---|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.4 | TEST FOR EMC (sample No. 7 YX511) | | |
| 8.4.1. | General | | |
| | Control circuit devices having only passive components are not required to be tested. | | N/A |
| | Subclauses 8.3.2.1 of IEC 60947-1 and 8.3.2.4 of IEC 60947-1 apply with the following additions: | | |
| | Control circuit devices intended to be mounted in a hole of a panel shall be mounted in a hole which is located in the centre of a grounded square metal plate. | | P |
| | Control circuit devices intended to be mounted on surfaces or on standard rails shall be mounted directly on the grounded square metal plate or on the standard rail which is fixed on the grounded square metal plate. | | P |
| | Control circuit devices intended to be mounted in associated metal enclosures shall be mounted in the grounded metal enclosure with the smallest dimension available or on the grounded square metal plate, whichever configuration yields the worst results. | | P |
| | The dimension of the square metal plate shall be (300 ± 50) mm and the thickness $1,5 \text{ }_0^{+0,5}$ mm. | | P |
| | If not required otherwise by horizontal standard the connecting leads shall be $2 \text{ }_0^{+0,1}$ m. If the length of the connecting leads is other than 2 m. Cable length (m).....: | | P |
| | For control circuit devices not having integral cables, the type of cable or wire used shall be specified by the manufacturer: Type of cable.....: | | N/A |
| | The test sample shall be in the ON-status or in the OFF-status, whichever is the worse. Tested state : | ON / OFF | N/A |
| | Where a range of control circuit devices are made according to the same principle and design, and using the same type of components, tests may be performed on representative samples. | | N/A |
| 8.4.2 | Immunity | | |
| 8.4.2.1 | Electrostatic discharges. | | |
| | The test shall be performed according to IEC 61000-4-2 and 7.3.2.4, and shall be repeated 10 times at each measuring point, with a minimum time interval of 1 s between pulses. | See | P |
| 8.4.2.2 | Radiated radio-frequency electromagnetic fields | | |
| | The test shall be performed according to IEC 61000-4-3 and 7.3.2.5. | See | P |
| 8.4.2.3 | Electrical fast transients/bursts | | |

| IEC 60947-5-1 | | | |
|---------------|--|---|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| | The test shall be performed according to IEC 61000-4-4 and 7.3.2.6, with all the connecting leads placed in the capacitive coupling clamp. | See | P |
| 8.4.2.4 | Surges | | |
| | The test shall be conducted using the methods of IEC 61000-4-5. Capacitive coupling shall be preferred. Surges shall be supplied between: | See | P |
| | a) between terminals intended to be connected to the power supply; | | P |
| | b) between each output terminal and each terminal intended to be connected to the power supply | | P |
| | The test voltage values are those of Table 8 but shall not exceed the corresponding U_{imp} value(s) given by the manufacturer following 7.2.3 of IEC 60947-1. Test voltages (V).....: | 2 kV (line to earth) 1 kV (line to line) | P |
| | The repetition rate shall be one surge per minute, with the number of pulses being five positive and five negative. | | P |
| 8.4.2.5 | Conducted disturbances induced by radio-frequency fields | | |
| | The test shall be performed according to IEC 61000-4-6 and 7.3.2.8. | See | P |
| 8.4.2.6 | Power-frequency magnetic fields | | |
| | The test shall be performed according to IEC 61000-4-8 and 7.3.2.9. | See | P |
| 8.4.2.7 | Voltage dips and interruptions | | |
| | The test shall be performed according to IEC 61000-4-11 and 7.3.2.10. | See | P |
| 8.4.3 | Emission | | |
| | The test shall be performed according to CISPR 11, group 1, class A, and 7.3.3. | See | P |

| IEC 60947-5-1 | | | |
|---------------------------------------|---|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |
| 8.3.1 | TEST SEQUENCE V | | N/A |
| 8.3.1. | TEST SEQUENCE VI | | N/A |
| Annex C of IEC 60947-1 | DEGREE OF PROTECTION OF ENCLOSED CONTROL CIRCUIT-DEVICES | | |
| Annex C | SPECIAL TESTS - DURABILITY TESTS | | |
| Annex E | ITEMS SUBJECT TO AGREE BETWEEN MANUFACTURER AND USER | | |
| Annex F | CLASS II CONTROL CIRCUIT DEVICES INSULATED BY ENCAPSULATION REQUIREMENTS AND TESTS | | |
| Annex G | ADDITIONAL REQUIREMENTS FOR CONTROL CIRCUIT DEVICES WITH INTEGRALLY CONNECTED CABLES | | |
| Annex H | ADDITIONAL REQUIREMENTS FOR SEMICONDUCTOR SWITCHING ELEMENTS FOR CONTROL CIRCUIT DEVICES | | |
| Annex J | SPECIAL REQUIREMENTS FOR INDICATOR LIGHTS AND INDICATING TOWERS | | |
| Annex K | SPECIAL REQUIREMENTS FOR CONTROL SWITCHES WITH DIRECT OPENING ACTION | | |
| Annex L | SPECIAL REQUIREMENTS FOR MECHANICALLY LINKED CONTACT ELEMENTS | | |
| Annex M | TERMINAL MARKING, DISTINCTIVE NUMBER AND DISTINCTIVE LETTER FOR CONTROL CIRCUIT DEVICES | | |
| Annex N | Procedure to determine reliability data for electromechanical devices in control circuits used in functional safety applications | | |

| IEC 60947-5-1 | | | |
|---------------|--------------------|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |

| TABLE: Heating Test (sample No. 1 YX542AH00) | | | P |
|--|--------------------------------|-----------------------------|---|
| Test voltage (V) | | - | — |
| Ambient (°C) | | +25 °C | — |
| Thermocouple Locations | Max. temperature measured, (K) | Max. temperature limit, (K) | |
| The terminals 1 | 8 | 70 | |
| The terminals 2 | 9 | 70 | |
| The terminals 3 | 11 | 70 | |
| The terminals 4 | 10 | 70 | |
| enclosure | 6 | 40 | |
| Supplementary information:N/A | | | |

| TABLE: Heating test, resistance method | | | | | | N/A |
|--|--------------------|--------------------|--------|-------------|------------------|-----|
| Test voltage (V) | | | | | | — |
| Ambient, t ₁ (°C) | | | | | | — |
| Ambient, t ₂ (°C) | | | | | | — |
| Temperature rise of winding | R ₁ (Ω) | R ₂ (Ω) | ΔT (K) | Max. dT (K) | Insulation class | |
| | | | | | | |
| Supplementary information: | | | | | | |

| TABLE: Dielectric Strength | | | N/A |
|---|----------------------------|--------------------------------|-----|
| Test voltage applied between: | Test potential applied (V) | Breakdown / flashover (Yes/No) | |
| between all the terminals of the main circuit connected together (including the control and auxiliary circuits connected to the main circuit) and the enclosure or mounting plate, with the contacts in all normal positions of operation | AC1500V | No | |
| between each pole of the main circuit and the other poles connected together and to the enclosure or mounting plate with the contacts in all normal positions of operation | AC1500V | No | |
| Supplementary information:N/A | | | |

| IEC 60947-5-1 | | | |
|---------------|--------------------|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |



| TABLE: Clearance And Creepage Distance Measurements | | | | | | N/A |
|---|--------|--------------|------------------|---------|-------------------|----------|
| clearance cl and creepage distance dcr at/of: | Up (V) | U r.m.s. (V) | Required cl (mm) | cl (mm) | required dcr (mm) | dcr (mm) |
| | | | | | | |
| | | | | | | |
| | | | | | | |
| | | | | | | |
| | | | | | | |
| Supplementary information: | | | | | | |

| TABLE: Distance Through Insulation Measurements | | | | N/A |
|---|--------------|------------------|------------------|---------|
| Distance through insulation di at/of: | U r.m.s. (V) | Test voltage (V) | Required di (mm) | di (mm) |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| Supplementary information: | | | | |

| IEC 60947-5-1 | | | |
|---------------|--------------------|-----------------|---------|
| Clause | Requirement + Test | Result - Remark | Verdict |

| TABLE: Needle- flame test (NFT) | | | | | N/A |
|---------------------------------|-------------------------|---|------------------------------------|------------------------------|---------|
| Object/ Part No./ Material | Manufacturer/ trademark | Duration of application of test flame (ta); (s) | Ignition of specified layer Yes/No | Duration of burning (tb) (s) | Verdict |
| | | | | | |
| | | | | | |
| | | | | | |

Supplementary information:
NFT not relevant (or applicable) for Parts of material classified as V-0 or V-1
NFT not relevant (or applicable) for Base material of PCBs classified as V-0 or if relevant VTM-0

| TABLE: Resistance to heat and fire - Glow wire tests | | | | | | | | P |
|---|---|---|-----|-----|-----|------------------------------|-----|---------|
| Object/ Part No./ Material | Manufacturer / trademark | Glow wire test (GWT); (°C) | | | | | | Verdict |
| | | 550 | 650 | | 750 | | 960 | |
| | | | te | ti | te | ti | | |
| ABS |  | | | | | | 30s | P |
| PC |  | | | | | | 30s | P |
| | | | | | | | | |
| Object/ Part No./ Material | Manufacturer / trademark | Glow-wire flammability index (GWFI), °C | | | | GW ignition temp. (GWIT), °C | | Verdict |
| | | 550 | 650 | 750 | 850 | 675 | 775 | |
| | | | | | | | | |
| The test specimen passed the glow wire test (GWT) with no ignition $[(t_e - t_i) \leq 2s]$ (Yes/No) : | | | | | | | | |
| If no, then surrounding parts passed the needle-flame test of annex E (Yes/No)..... : | | | | | | | | |
| The test specimen passed the test by virtue of most of the flaming material being withdrawn with the glow-wire (Yes/No)? : | | | | | | | | |
| Ignition of the specified layer placed underneath the test specimen (Yes/No)..... : | | | | | | | | |
| Supplementary information: 550 °C GWT not relevant (or applicable) to parts of material classified at least HB40 or if relevant HBF The GWIT pre-selection option, the 850 °C GWFI pre-selection option, and the 850 °C GWT are not relevant (or applicable) for attended appliances. | | | | | | | | |